

1 ELECTRICAL SITE PLAN
1" = 20'-0"

GENERAL NOTES

- A. ALL WORK SHOWN IS NEW AND PROVIDED BY THE ELECTRICAL CONTRACTOR UNLESS OTHERWISE INDICATED.
B. REMOVE OR RELOCATE ANY AND ALL EXISTING SERVICES, POLES, ETC., AS MAY BE REQUIRED TO ACCOMMODATE NEW CONSTRUCTION UNLESS OTHERWISE INDICATED.
C. COORDINATE ALL INCOMING ELECTRICAL SERVICE WORK WITH THE ELECTRICAL UTILITY COMPANY. PAY ALL FEES AND OTHER COSTS NOT BORNE BY THE ELECTRICAL UTILITY COMPANY TO PROVIDE NEW ELECTRICAL SERVICES TO THE PROJECT BUILDINGS.
D. COORDINATE ALL INCOMING TELEPHONE SERVICE WORK WITH THE LOCAL TELEPHONE UTILITY COMPANY. PAY ALL FEES AND OTHER COSTS NOT BORNE BY THE LOCAL TELEPHONE UTILITY COMPANY TO PROVIDE NEW TELEPHONE SERVICES TO THE PROJECT BUILDINGS.
E. PROVIDE PULL STRINGS IN ALL UTILITY CONDUITS.
F. ALL EXTERIOR CONDUITS SHALL BE INSTALLED BELOW THE FROST LINE.
G. COORDINATE LOCATIONS OF ALL UNDERGROUND CONDUITS, HANDHOLES AND MANHOLES, UNDERGROUND DRAINS, SERVICES, STRUCTURES, AND PAVING.
H. PROVIDE ADDITIONAL HANDHOLES AND MANHOLES AS REQUIRED BY THE UTILITY COMPANIES. COORDIANTE REQUIREMENTS WITH UTILITY COMPANIES PRIOR TO BID.
I. COORDINATE COORDINATE ALL ROUTING AND TERMINATION LOCATIONS WITH THE UTILITY COMPANIES PRIOR TO BID.

PLAN NOTES

1. DISCONNECT AND REMOVE EXISTING UTILITY METER COMPLETE.
2. EXISTING SECONDARIES. PROTECT EXISTING SERVICES.
3. PROVIDE CONDUITS FROM TRANSFORMER SECONDARY TO P1* FOR CONDUCTORS. REFER TO ELECTRICAL ONE-LINE RISER DIAGRAM FOR ADDITIONAL INFORMATION.
4. UTILITY METER LOCATION. COORDINATE ALL REQUIREMENTS AND LOCATION WITH UTILITY. PROVIDE ADDITIONAL SUPPORT STRUCTURE AS REQUIRED AS REQUIRED BY THE UTILITY. REFER TO ELECTRICAL ONE-LINE RISER DIAGRAM FOR ADDITIONAL INFORMATION.
5. PROVIDE 2" 4" TELECOM SERVICE ENTRANCE CONDUITS FROM TELECOM BACKBOARD TO EXISTING TELECOM PEDESTAL.
6. EXISTING DUKE ENERGY SITE LIGHT TO BE RELOCATED BY UTILITY.
7. EXISTING DUKE ENERGY SITE LIGHT.
8. DUKE ENERGY TO PROVIDE SITE LIGHTING.
9. FUTURE ELECTRIC VEHICLE CHARGING STATION. PROVIDE QUAZITE BOX, CONDUIT AND BREAKER ONLY.
10. GENERATOR. PROVIDE CONCRETE PAD PER MANUFACTURERS REQUIREMENTS. REFER TO ELECTRICAL RISER DIAGRAM ON SHEET E701 FOR ADDITIONAL INFORMATION.
11. CIRCUIT CONNECTION TO BATTERY CHARGER. VERIFY LOCATION.
12. PROVIDE 2P-30A, 208V, NEMA 3R FUSIBLE DISCONNECT SWITCH FOR BLOCK HEATER. FUSE PER MANUFACTURERS RECOMMENDATIONS.

UTILITY CONTACT INFO FOR SITE LIGHTING:
DUKE ENERGY
BRONSON GOSS
BRONSON.GOSS@DUKE.ENERGY.COM
(812) 374-3742



WINDROSE

WINDROSE FRANKLIN CLINIC EXPANSION

ARCHITECT

DELV Design
212 W 10th St, STE F125
Indianapolis, IN 46202
(317) 296-7400

MEP


Genesis Engineering Group
91 S Main St #200
Zionsville, IN 46077
(317) 927-8307

STRUCTURAL

JPS Consulting Engineers
9365 Counselors Row
Indianapolis, IN 46240
(317) 617-4270

CIVIL

JPS Consulting Engineers
9365 Counselors Row
Indianapolis, IN 46240
(317) 617-4270

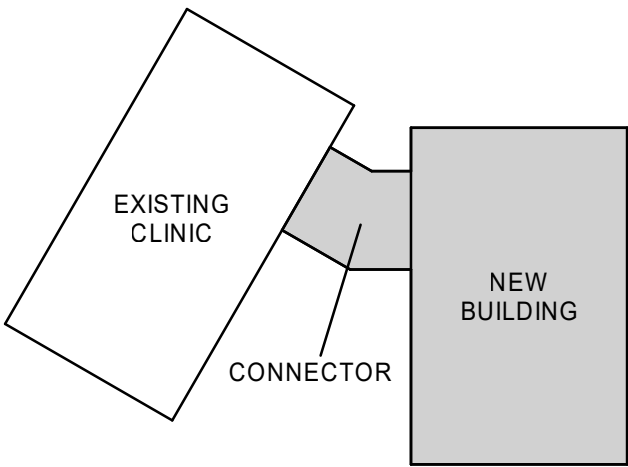

1ST FLOOR KEY PLAN

CONSTRUCTION DOCUMENTS



No.	Description	Date

CLIENT PROJ. #: N/A
PROJECT #: 20-061
ISSUE DATE: 5/12/22
DRW: JAW | CHK: JAW

ELECTRICAL SITE PLAN

E100

Windrose Health Lighting

■ Pad Mount Transformer

— Conduit / Wire

Poles

● Existing

● Proposed

● Relocated

Lighting Footprints

— 0.25 ft candles

— 0.5 ft candles

— 1 ft candles



0 75 150 ft



Windrose Health Lighting

■ Pad Mount Transformer

— Conduit / Wire

Poles

● Existing

● Proposed

● Relocated

Lighting Footprints

— 0.25 ft candles

— 0.5 ft candles

— 1 ft candles

